

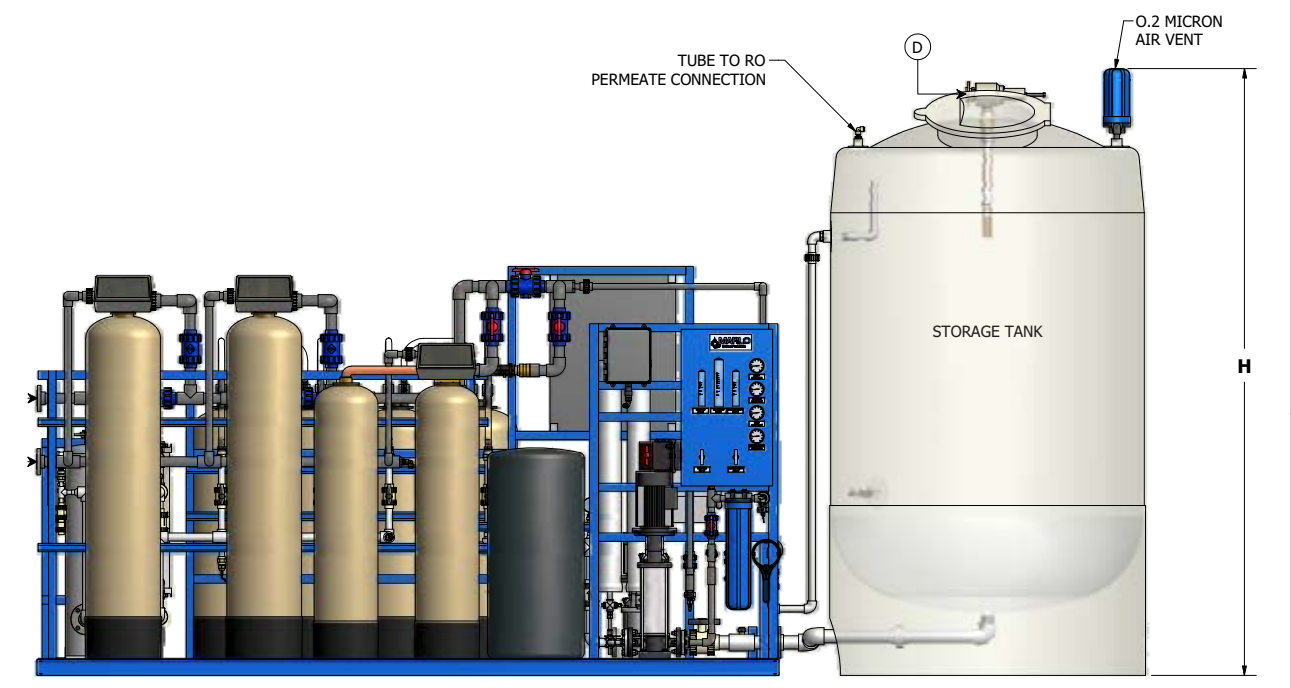
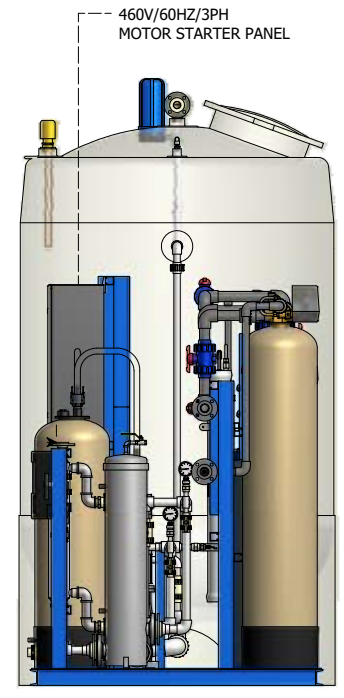
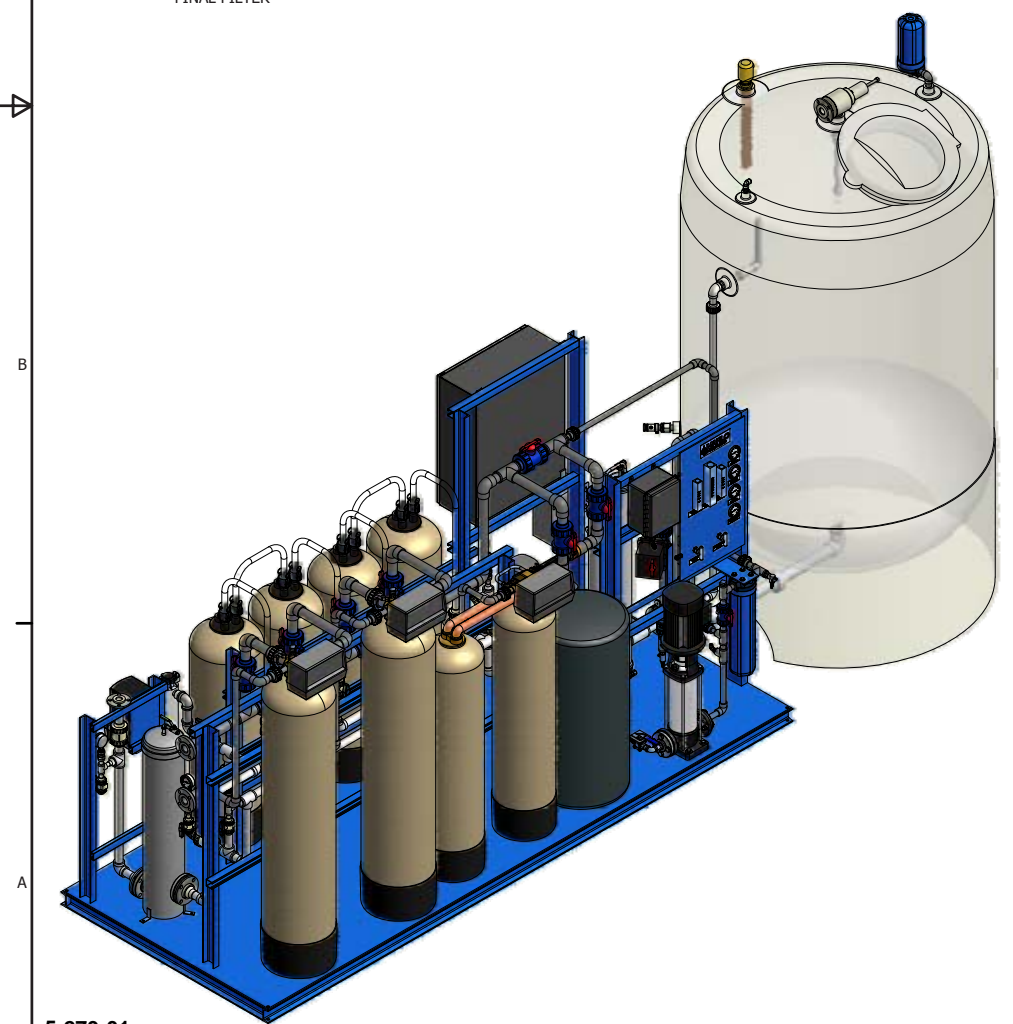
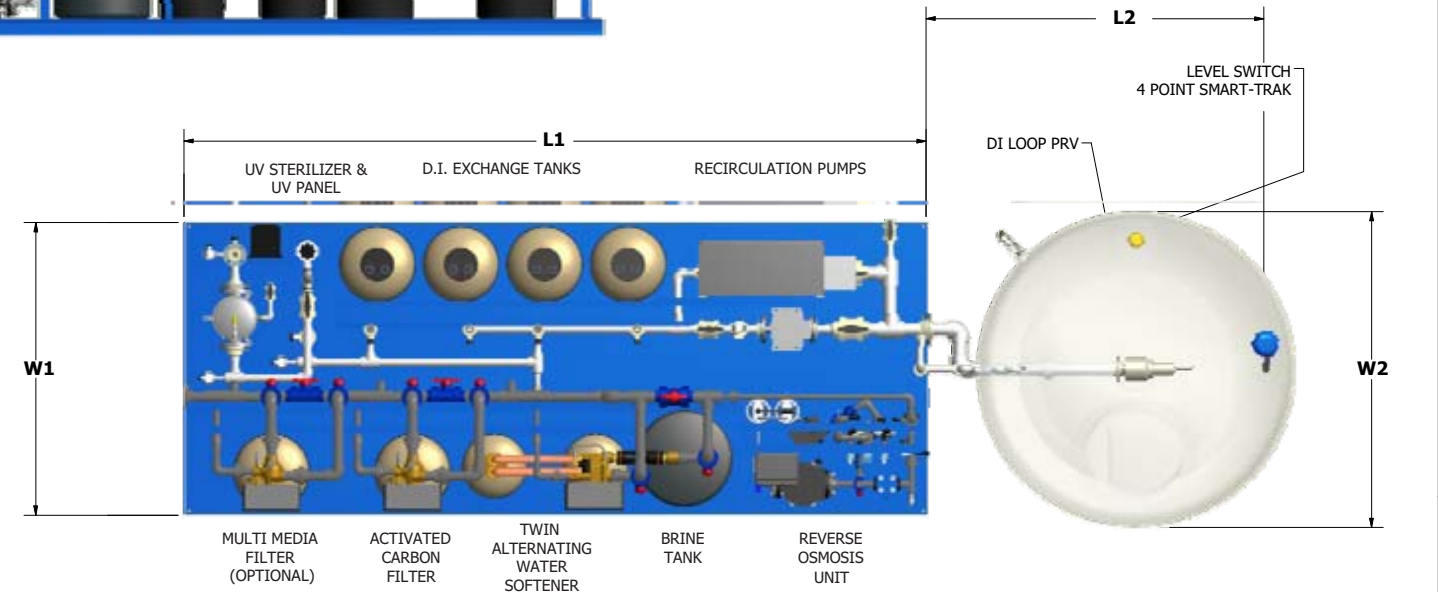


CONNECTION SCHEDULE						
ITEM	DESCRIPTION	LOCATION	MAX FLOW	SIZE	CONNECTION	MATERIAL
A	RAW WATER INLET	HIGH PURITY SKID	GPM	in	150# FLG. RF	PVC SCH 80
B	CONCENTRATE/ WASTE OUTLET	HIGH PURITY SKID	GPM	in	150# FLG. RF	PVC SCH 80
C	HIGH PURITY LOOP FEED	HIGH PURITY SKID	GPM	in	150# FLG. RF	PP
D	HIGH PURITY LOOP RETURN	HIGH PURITY SKID	GPM	in	150# FLG. RF	PP
E	TANK EMERGENCY OVERFLOW	HIGH PURITY SKID	GPM	in	150# FLG. RF	PP

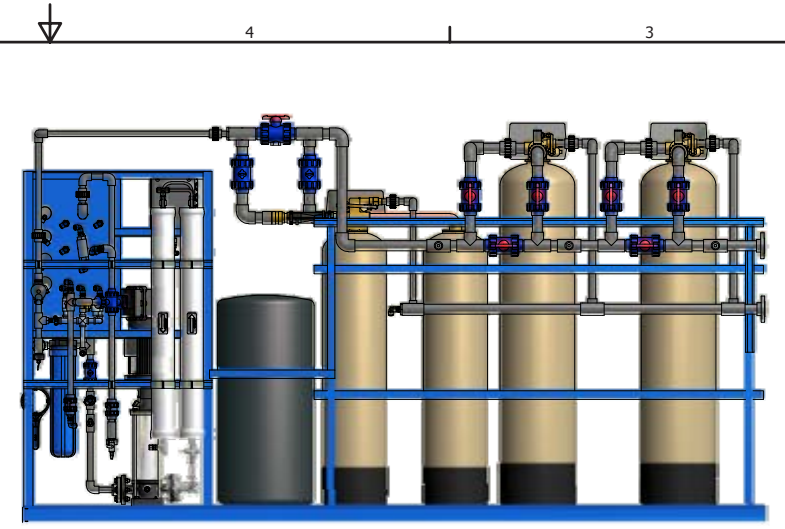

5-279-01

REVISIONS				
NO.	DATE	BY	REVISIONS	REMARKS

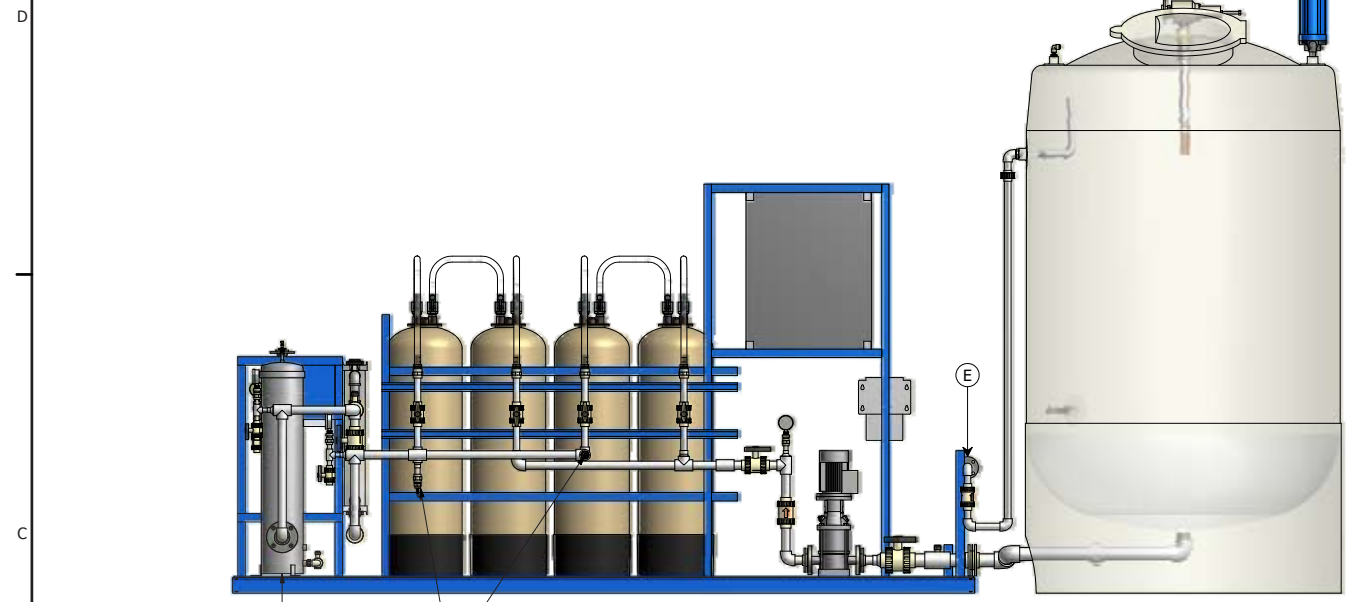

HIGH PURITY WATER TREATMENT SKID GENERAL ARRANGEMENT DRAWING				
FRAC.	DEC.	FILE ID.		
DRN.	Anthony	SCALE	SHEET 1 OF 1	
APPD.	SPL	DRAWING NO.		
DATE	9/28/2010			